



- NOTES**
- 1.0 DUCTS SHALL RUN WITHIN CEILING. ALL BR/PPR PIPES WITHIN 300mm CLEAR CEILING SPACE REQUIRED.
 - 2.0 DOOR GRILLES SUPPLIED BY MECHANICAL CONTRACTOR & INSTALLED BY BUILDER.
 - 3.0 RAIN REFRIGERANT PIPES, WIRING CONTROLS & CONDENSATE DRAIN PIPES IN WALL/CEILING VOIDS.
 - 4.0 ACCESS PANELS BY BUILDER.
 - 5.0 ALL EXHAUST DISCHARGES TO HAVE FAN/ROOF REQUIRED SEPARATION DISTANCES FROM ACCESSIBLE FRESH AIR INTAKES AS ACCORDANCE TO THE REQUIREMENTS OF AS1668.2.

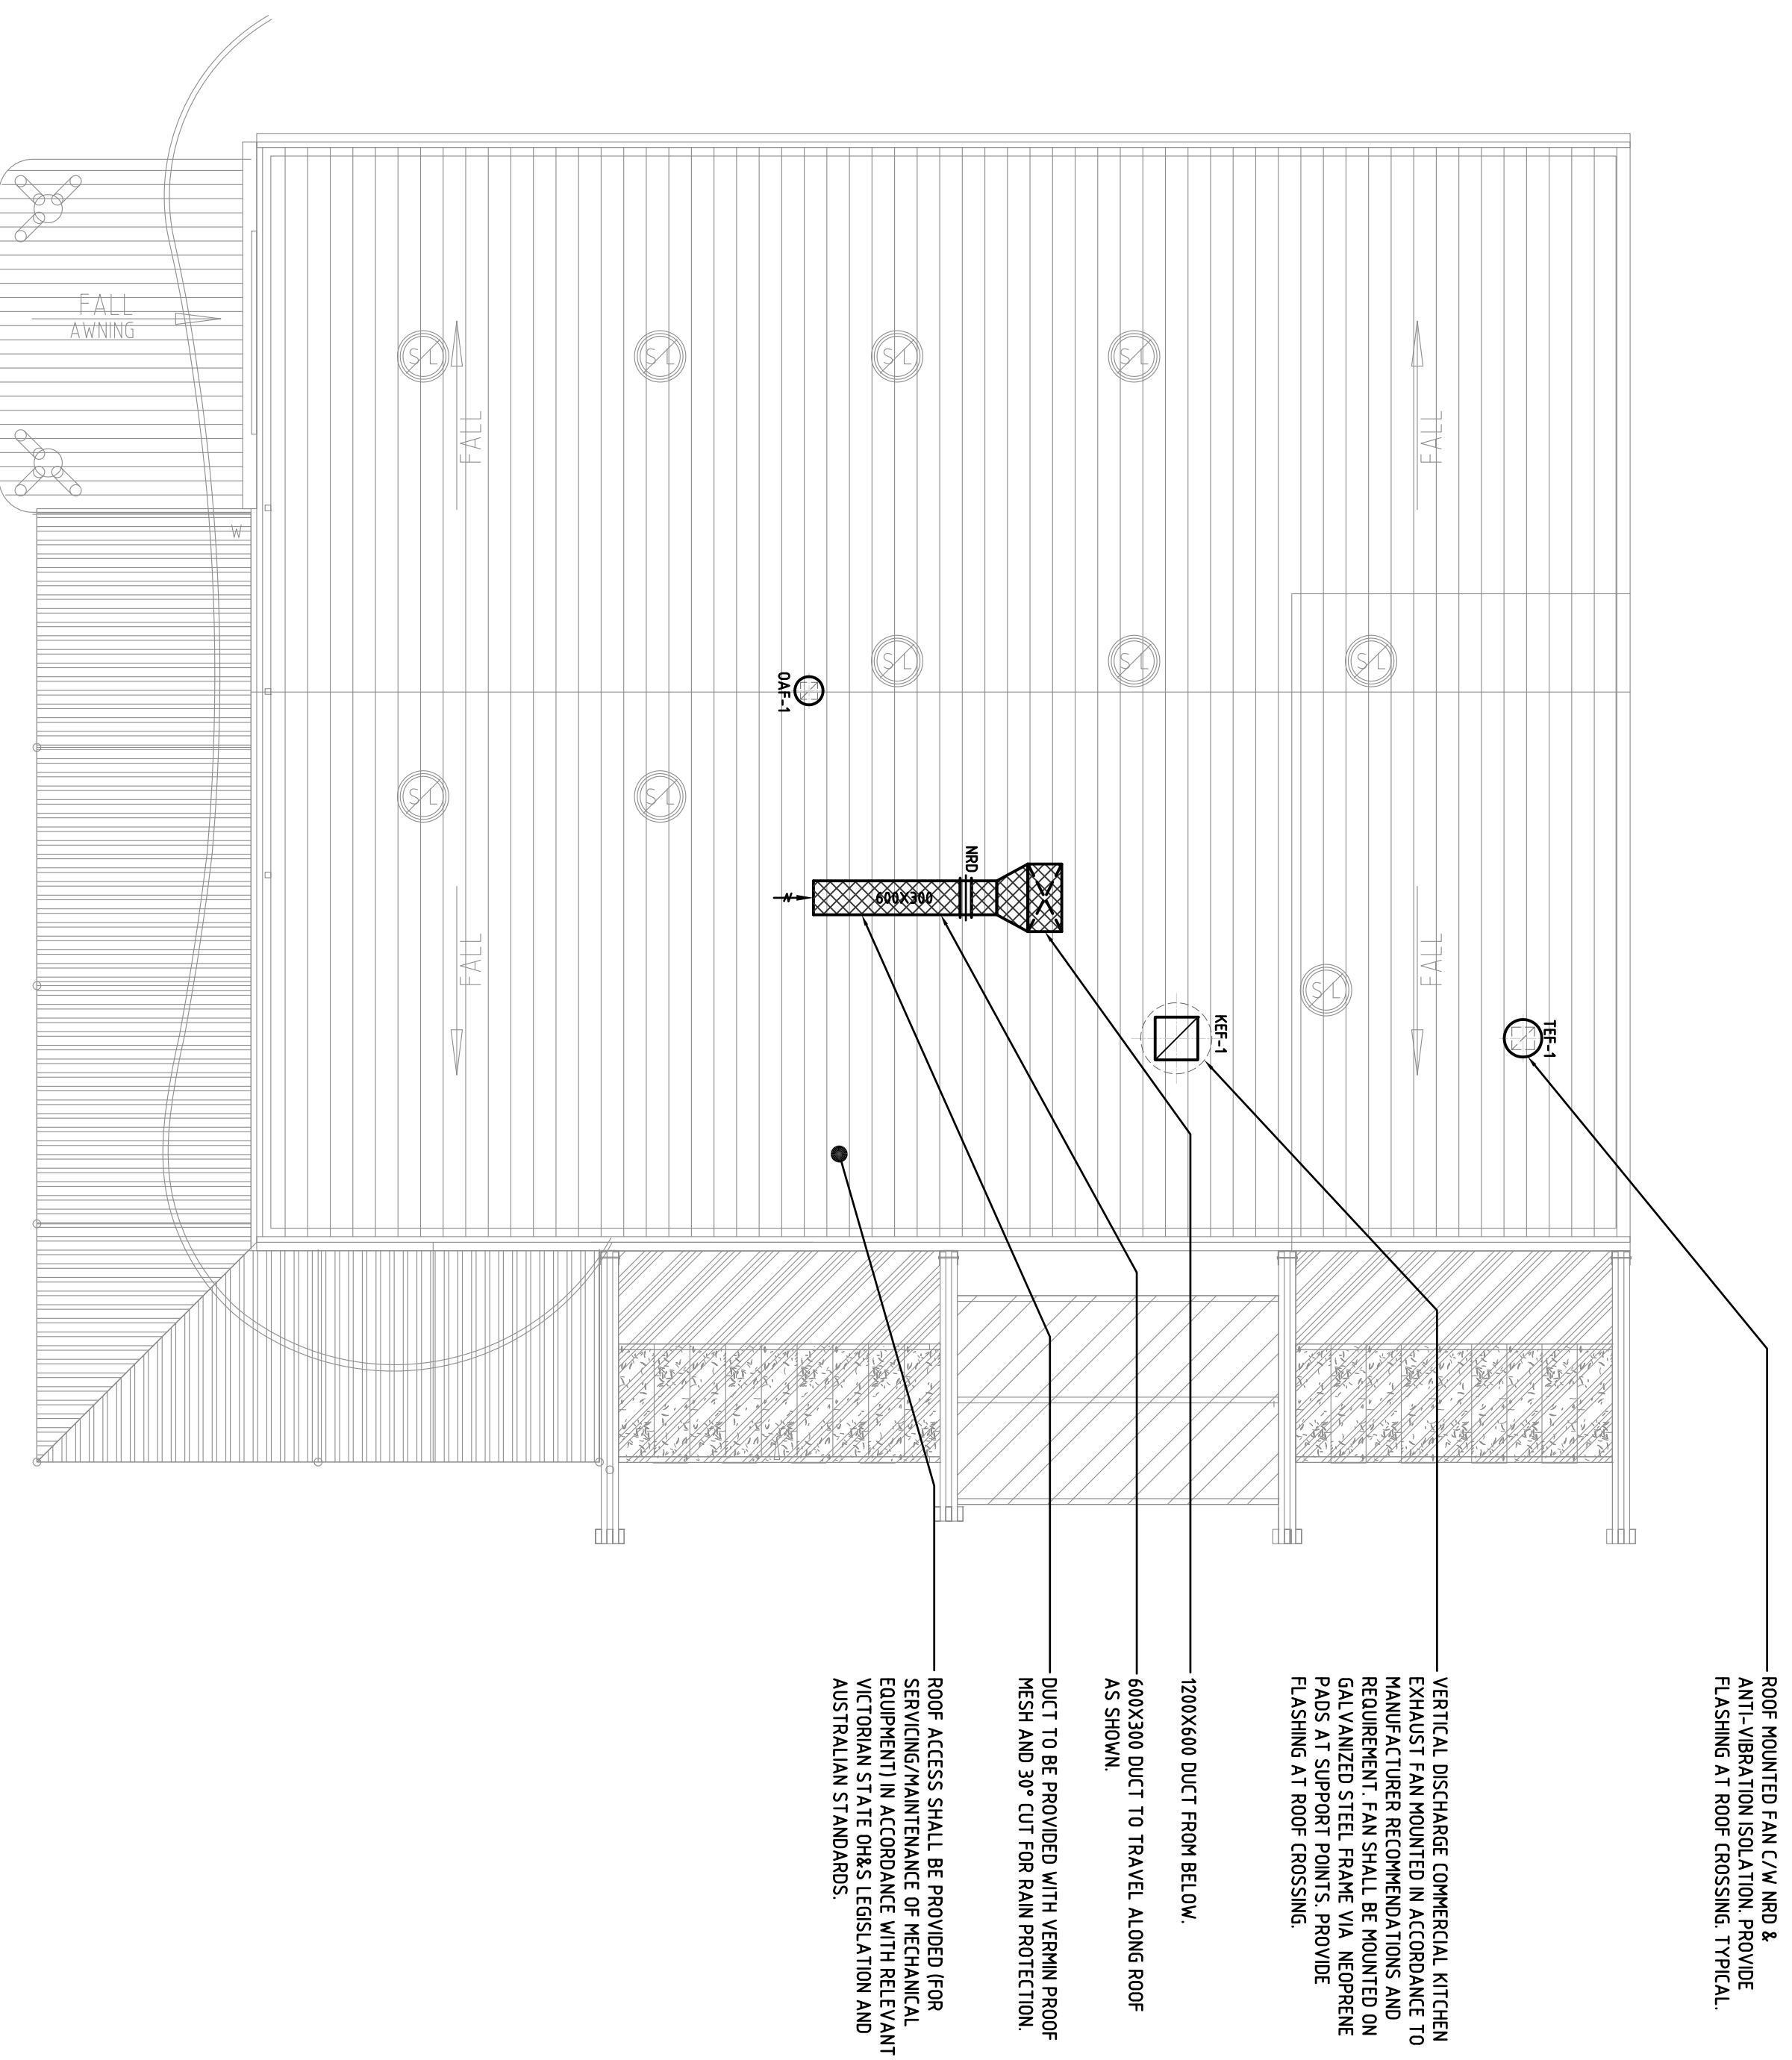

NOT FOR CONSTRUCTION

REV. NO.	AMENDMENT	DATE	REV. NO.	AMENDMENT	DATE
A	REVISED TENDER ISSUE	18-10-18			
Ø	TENDER ISSUE	12-10-18			
F1	PRELIMINARY ISSUE	22-09-18			

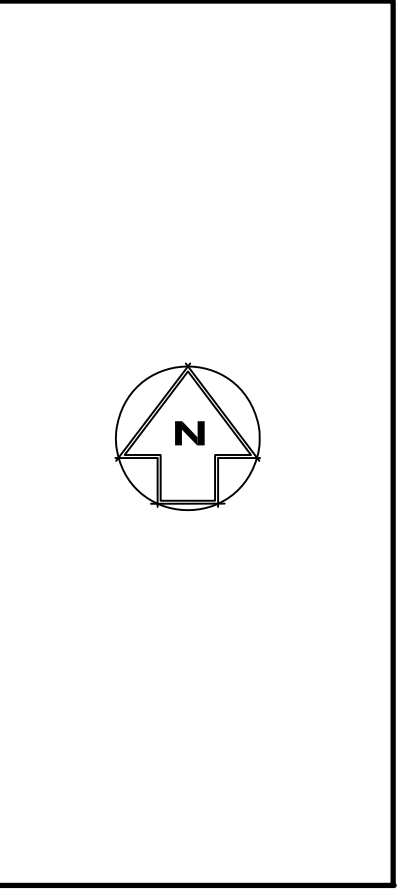

ARCHITECT:

CARTMAN DESIGNS

SUITE 512 EXPERIENCE BUSINESS CENTRE
 80 PRINSEP STREET
 PERTH WA 6000
 PH: (08) 9471 1255 FAX: (08) 9471 0235
 EMAIL: INFO@CARTMANDESIGNS.COM.AU

NJMdesign
 consulting engineers

NJM Design Pty Ltd
 Level 12, 461 Bourke St, Melbourne, VIC 3000
 Tel: (03) 9600 4400
 Fax: (03) 9600 4170
 Email: nial@njmdesign.com.au
 Internet: www.njmdesign.com.au

PROJECT:

SHIRE OF DUNDAS WOODLANDS CULTURAL COMMUNITY AND VISITORS CENTRE PROJECT
 80 PRINSEP STREET, NORSEMAN WA 6443

FOR:
 CARTMAN WA PTY, LTD

WORK STAGE: PRELIMINARY

DATE: AUG 2018

DESIGNED/DRAWN: R/ / GM

SCALE: 1:100 @ A1

TITLE: MECHANICAL SERVICES ROOF PLAN DUCT & EQUIPMENT LAYOUT

PROJECT NO: 5460

DRAWING NO: M03

N.O. OF SHEETS: 3 of 3

REVISION: A